


4014
89

4014-89

06/30/04

EMERGENCY CONTACTS

Maintenance Manager - Jesus Padilla = cell
Board of Director -

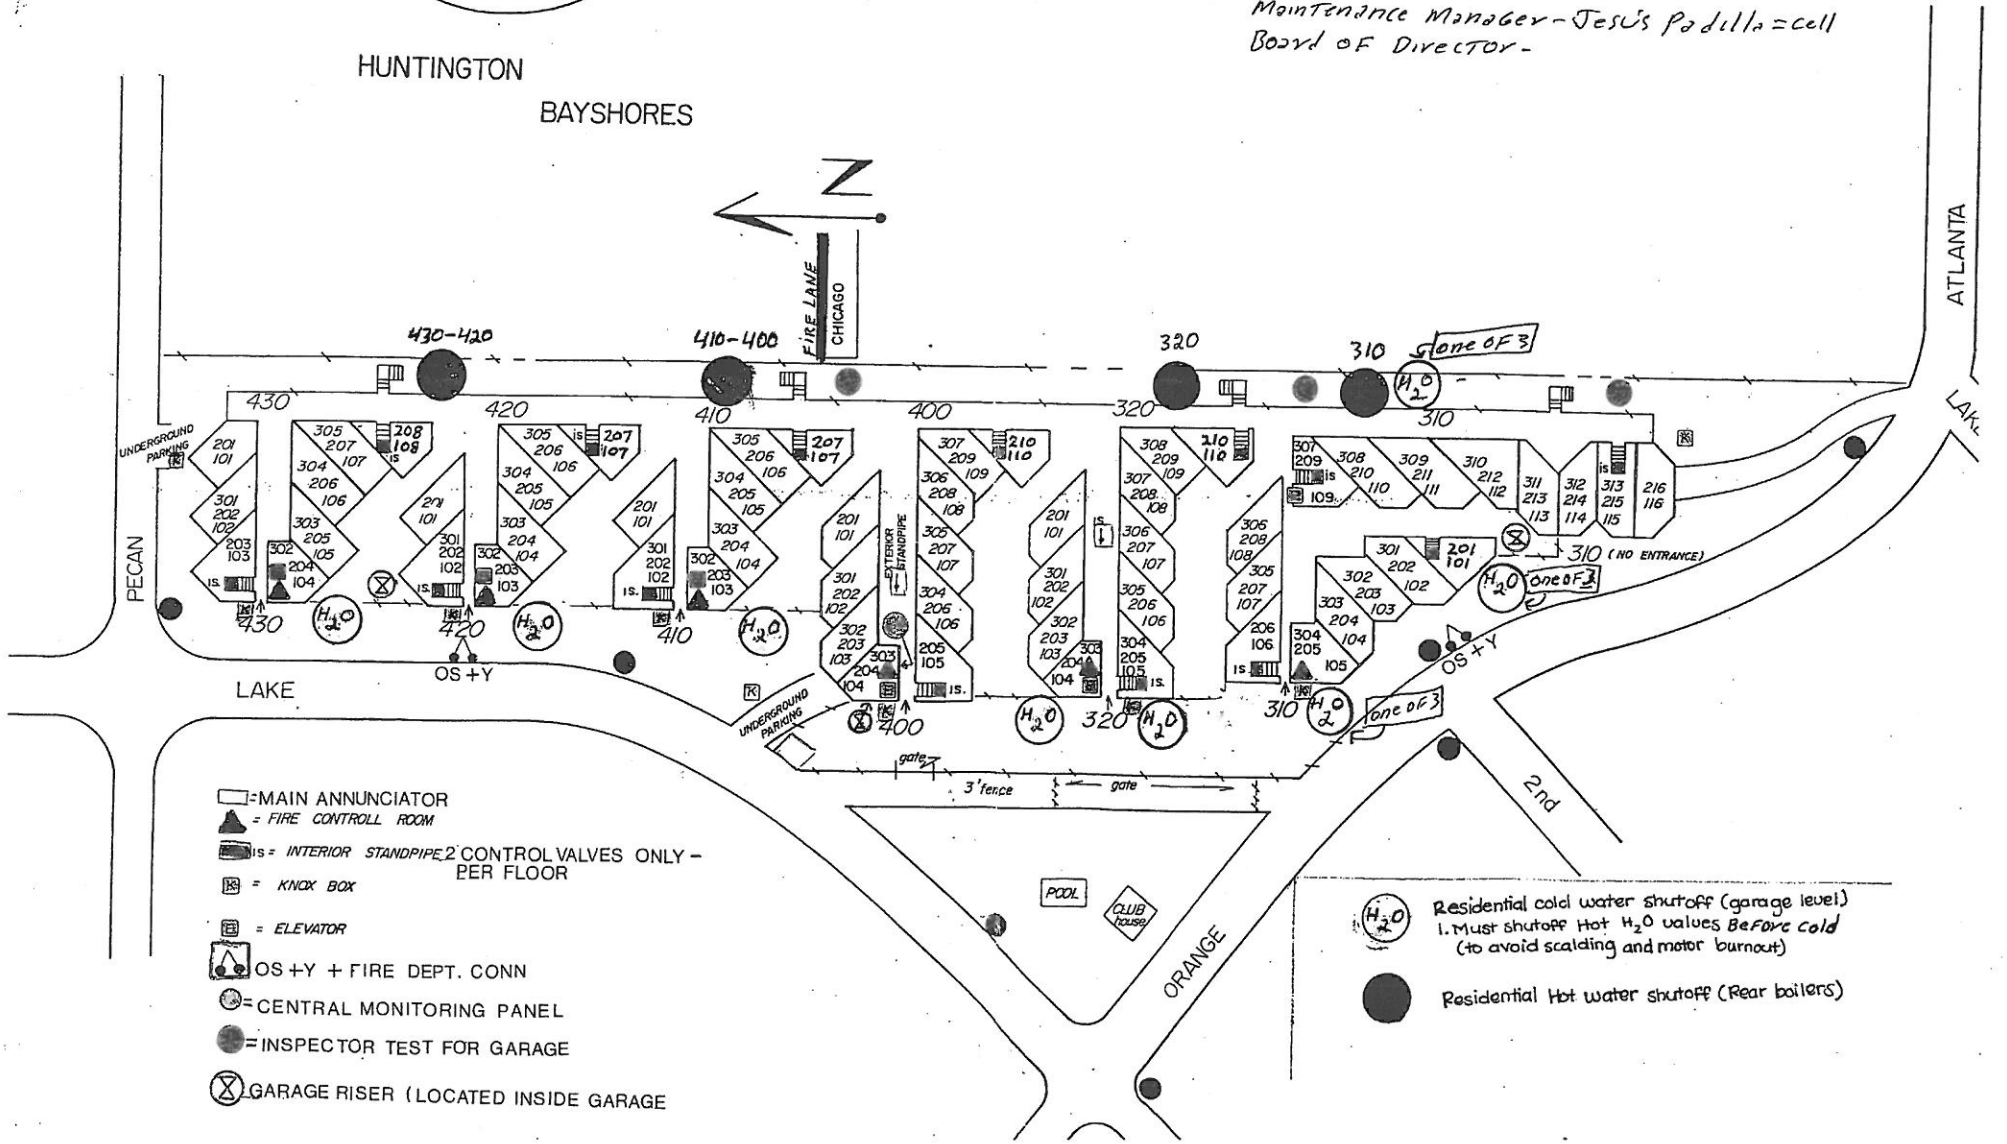

- = MAIN ANNUNCIATOR
- ▲ = FIRE CONTROL ROOM
- is = INTERIOR STANDPIPE CONTROL VALVES ONLY - PER FLOOR
- ⊗ = KNIX BOX
- ⊞ = ELEVATOR
- ⊞ OS + Y + FIRE DEPT. CONN
- = CENTRAL MONITORING PANEL
- = INSPECTOR TEST FOR GARAGE
- ⊗ = GARAGE RISER (LOCATED INSIDE GARAGE)

- ⊞ H₂O Residential cold water shutoff (garage level)
1. Must shutoff Hot H₂O valves BEFORE cold (to avoid scalding and motor burnout)
- Residential Hot water shutoff (Rear boilers)